


AG - 150A CONTROLLER

CITY MULTI

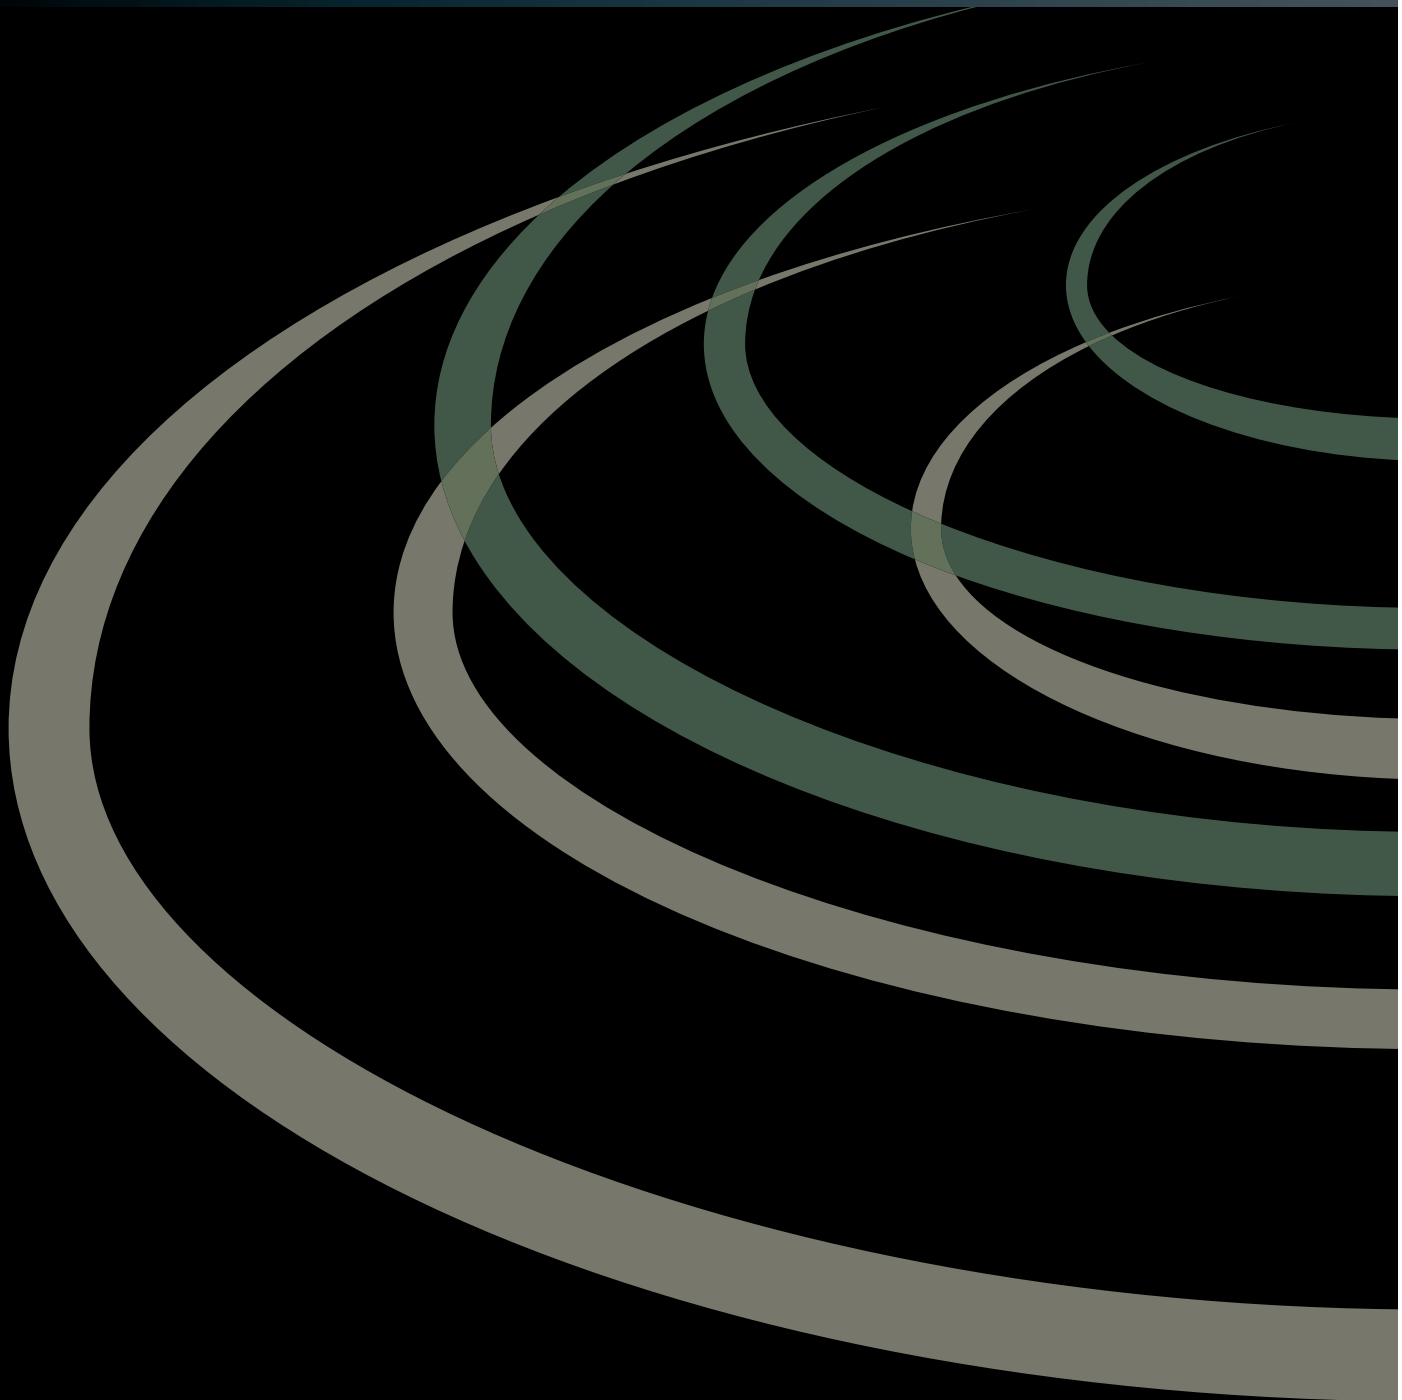

AG - 150A CONTROLLER

Touch Screen Centralised Controller with WebServer Capabilities

The new AG-150A Mitsubishi Electric centralised controller offers a large 9 inch touch screen display with easy control of up to 50 indoor units. The AG-150A can calculate the energy used for each system, zone or indoor unit, when used together with TG-2000 software. The refrigerant status check function can be activated regularly (in conjunction with the new YHM-A City Multi range) and an Internet connection with SSL security is also available to monitor and control the AG-150A remotely and receive email under fault conditions.



New Design

Backlight Colour liquid crystal display

9 inch wide, high-resolution
Backlight makes it easy to
see and control units.
One can identify whether a unit is
ON or OFF from a distance.

Touch panel

Touch panel enables operation of units by touching with index finger.
When object unit is touched, orange box appears
around the unit icon indicating the unit selected.

Flat Back

Easy installation
Allows for an installation of the unit either directly to the
wall surface or using the installation hole in the wall.

USB memory compatible

* From Dec. 2008

All measurement/initial setting CSV data extractable with USB memory
Can save and overwrite operation and setting data.

New Functions

Controllable units/groups

Controls up to 50 units / groups (including indoor units, LOSSNAY, DIDO/AI/PI controller)
 Up to 150 units can be controlled via expansion controller *From April 2009

Monitoring functions


Temperature / Humidity (using AI controller with WEB browser) *1
 General equipment such as lights on LCD (using DIDO controller)
 Interlock function between indoor units and AI controller, DIDO controller available *From April 2009 *1

Energy saving functions

Seasonal scheduling and automatic switch over *1
 Yearly scheduling on LCD *1
 Scheduling fan speed and airflow direction
 Optimized Start up control *From Dec. 2008 *1
 Sliding temperature control *From Dec. 2008 *1
 Setback function *From Dec. 2008 *1

*1 License required.

System structure

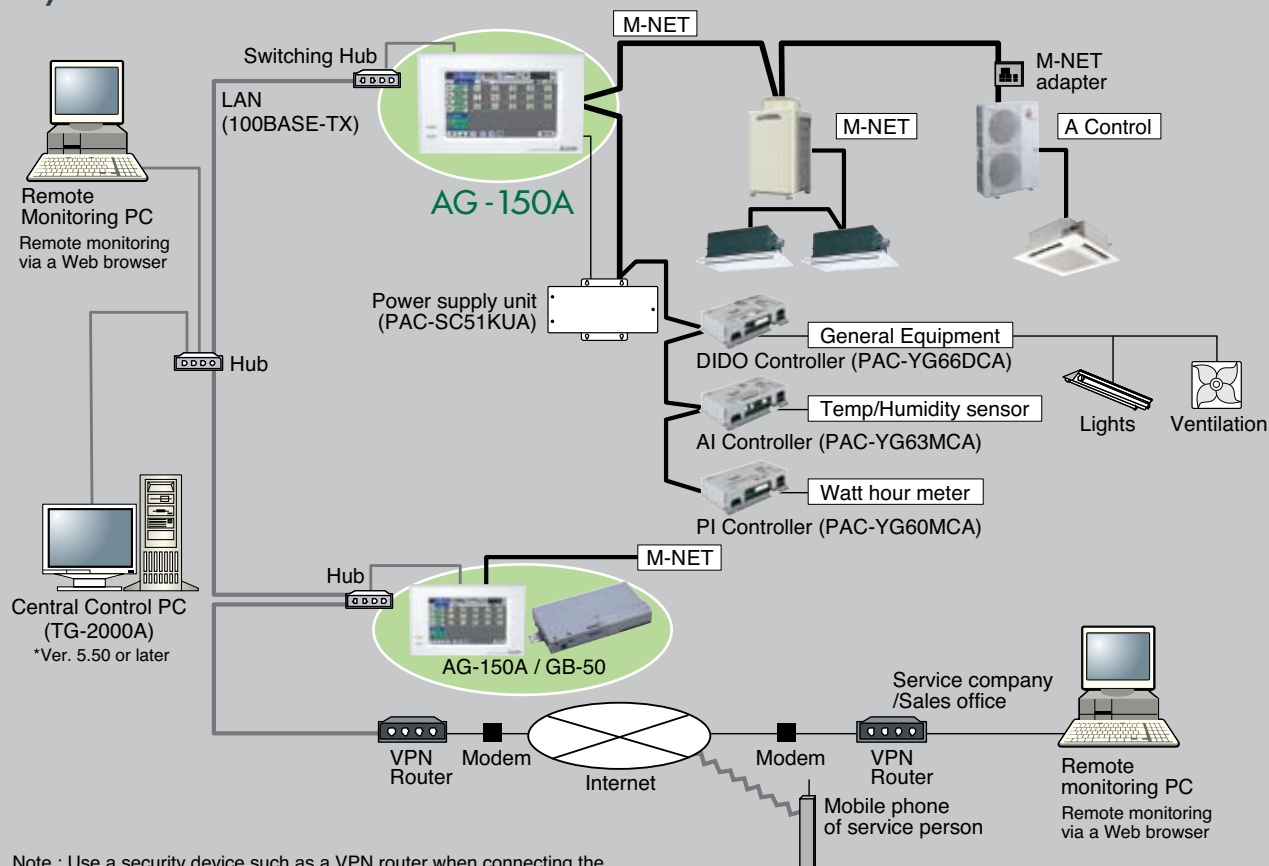


◆ Future release schedule is subject to change without notice.

Functions

Item	Description	Operations	Display
Controllable unit	Up to 50 units/groups.		
ON/OFF	Run and stop operation for the air conditioner units and general equipment. To operate general equipment, PAC-YG66DCA is required.	○ ◎ △ ●	○ ◎
Operation mode switching	Switches between Cool / Dry / Auto / Fan / Heat. (Group of LOSSNAY unit : automatic ventilation/ vent - heat interchange/ normal ventilation) depending on the air conditioner unit. Auto mode is for City Multi R2 and WR2 series only.	○ ◎ △ ●	○
Temperature setting	Cool/Dry : 19°C (67°F) - 30°C (87°F) [14°C (57°F) - 30°C (87°F)] Heat : 17°C (63°F) - 28°C (83°F) [17°C (63°F) - 28°C (83°F)] Auto : 19°C (67°F) - 28°C (83°F) [17°C (63°F) - 28°C (83°F)] [] in case of using middle-temperature on PDFY, PEFY-VML/VMR/VMS/VMH-by setting DipSW7-1 to ON. Yet, PEFY-P-VMH-E-F is excluded.	○ ◎ △ ●	○
Fan speed setting	Models with 4 air flow speed settings: Hi/Mid-2/Mid-1/Low Models with 3 air flow speed settings: Hi/Mid/Low Models with 2 air flow speed settings: Hi/Low Fan speed setting (including Auto) varies depending on the model.	○ ◎ △ ●	○
Air flow direction setting	Air flow direction angles, 4-angle or 5-angle Swing, Auto (Louver cannot be set)	○ ◎ △ ●	○
Schedule operation	Weekly schedule can be set by groups based on daily operation pattern.	○ ◎ △ ●	○
Permit / Prohibit local operation	Individually prohibit operation of each local remote control function (Start/Stop, Change operation mode, Set temperature, Reset filter).	○ ◎ △ ●	○
Indoor unit intake temperature	Measures the intake temperature of the indoor unit only when the indoor unit is operating.	×	○
Error	When an error is currently occurring on an air conditioner unit, the afflicted unit and the error code are displayed.	×	□ ◎
Test run	This operates air conditioner units in test run mode.	○ ◎ △ ●	○
Ventilation interlock	The ventilation unit (LOSSNAY) is able to automatically start its operation when operation of the interlocked indoor unit starts.	○ ◎ △ ●	○
External input/output	By using optional external input/output adaptor (PAC-YG10HAA) you can set and monitor the following. Input : By level signal : "Batch start/stop", "Batch emergency stop" By pulse signal : "Batch start/stop", "Enable/disable local remote controller" Output : "Start/stop", "Error/Normal"	◎	◎

*NOTE: Operation and displayed content vary depending on the indoor unit model.

External dimensions

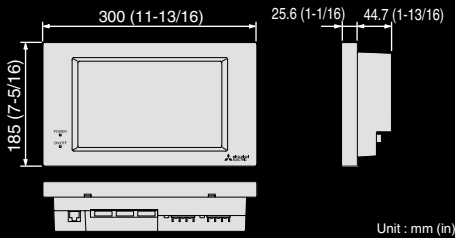

Options

Options	model name
Power supply unit	PAC-SC51KUA
Electric box	PAC-YG83UTB
Mounting attachment A type (Used with power supply unit)	PAC-YG85KTB
Mounting attachment B type (Used without power supply unit)	PAC-YG81TB
External input/output adaptor	PAC-YG10HA
Black surface cover	PAC-YG71CBL



PAC-YG71CBL



The Air Conditioning & Refrigeration Systems Works acquired ISO 9001 certification under Series 9000 of the International Standard Organization (ISO) based on a review of Quality management for the production of refrigeration and air conditioning equipment. ISO Authorization System
The ISO 9000 series is a plant authorization system relating to quality management as stipulated by the ISO. ISO 9001 certifies quality management based on the "design, development, production, installation and auxiliary services" for products built at an authorized plant.



The Air Conditioning & Refrigeration Systems Works acquired environmental management system standard ISO 14001 certification. The ISO 14000 series is a set of standards applying to environmental protection set by the International Standard Organization (ISO).

MITSUBISHI ELECTRIC AUSTRALIA PTY LTD.

(Incorporated in New South Wales) ABN 58 001 215 792

New South Wales

348 Victoria Road
Rydalmere NSW 2116
Phone 02 9684 7555
Fax 02 9898 1043

Newcastle

271 Brunner Road,
Adamstown NSW 2289
Phone 02 4978 7813
Fax 02 4978 7899

Canberra

Mobile 0408 650 822
Fax 02 6297 9067

Victoria/Tasmania

Omnico Business Park
Building 28
270 Ferntree Gully Road
Notting Hill VIC 3168
Phone 03 9535 7800
Fax 03 9535 7801

Queensland/

Northern Territory
Unit 12, 469 Nudgee Road
Hendra QLD 4011
Phone 07 3623 2000
Fax 07 3630 1888

North QLD - Townsville

Mitsubishi Electric Office
302 Woolcock Street
Garbutt QLD 4814
Phone 07 4728 5223
Fax 07 4728 5102
Capricorn Air
13 Mackley Street
Garbutt QLD 4814
Phone 07 4775 5222
Fax 07 4775 5305

South Australia

77 Port Road
Hindmarsh SA 5007
Phone 08 8340 2000
Fax 08 8340 0555

Western Australia

Unit 5, 329 Collier Road
Bassendean WA 6054
Phone 08 9377 3400
Fax 08 9377 3499

www.MitsubishiElectric.com.au